


WATER SECURITY STATUS REPORT

December 2025

Overall water security position

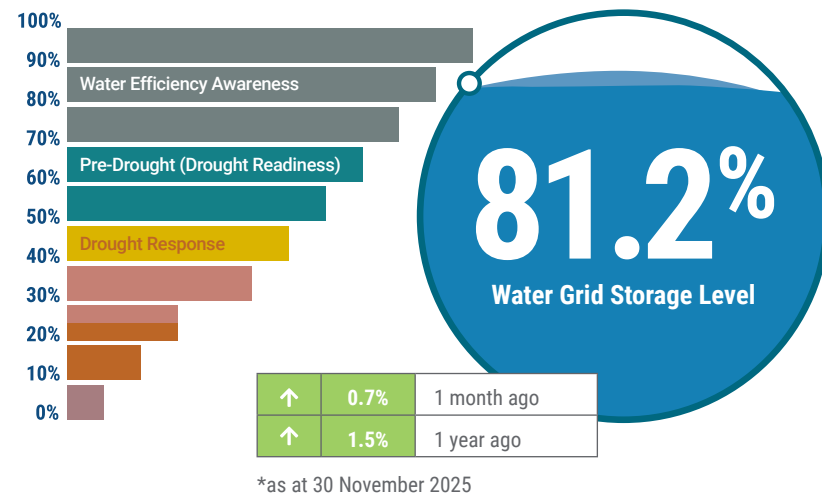


In November, rainfall was above average across the region, while maximum temperatures were above average. Water Grid Storage (WGS) level increased by 0.7% in November 2025.

The El Niño–Southern Oscillation (ENSO) is currently in a negative state. Weekly values of the relative Nino3.4 index have been fluctuating around the La Nina threshold since mid to late September. The Bureau's model currently predicts the tropical Pacific is likely to continue at La Niña levels till the end of the year before returning to neutral early in 2026.

Storage levels are now sitting at 81.2% (at 30 November 2025) meaning the region is in the Water Efficiency Awareness phase of the SEQ Drought Response Plan. BOM advises there is a 50 to 55% chance of above median rainfall in December to February, and a 60 to 80% chance of above median maximum temperatures.


Queensland rainfall percentages

01 November 2025 to 30 November 2025
Australian Gridded Climate Data

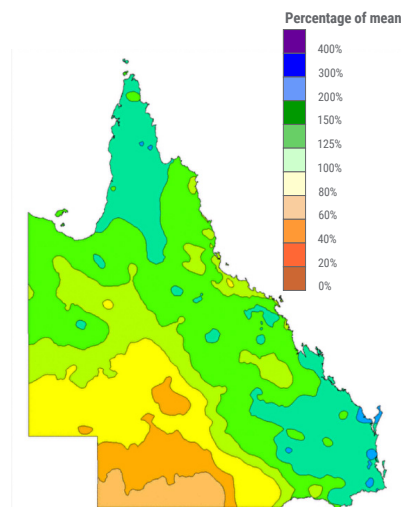

Queensland rainfall deciles


01 November 2025 to 30 November 2025
Australian Gridded Climate Data

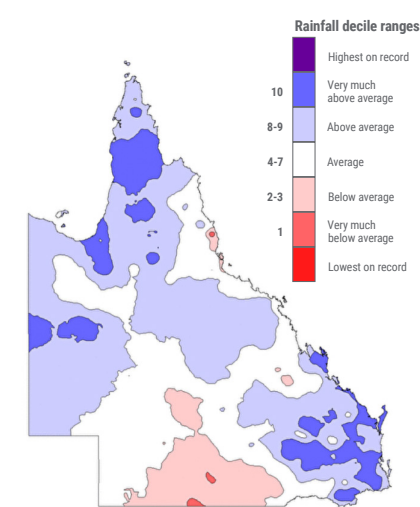

Water Grid storage

Sea Surface Temperatures (SSTs) in November 2025 were the second warmest on record.


If very dry conditions return (similar to the very dry year of 2019) storages could return to 70% by July 2026, and to a level of 60% by December 2026.

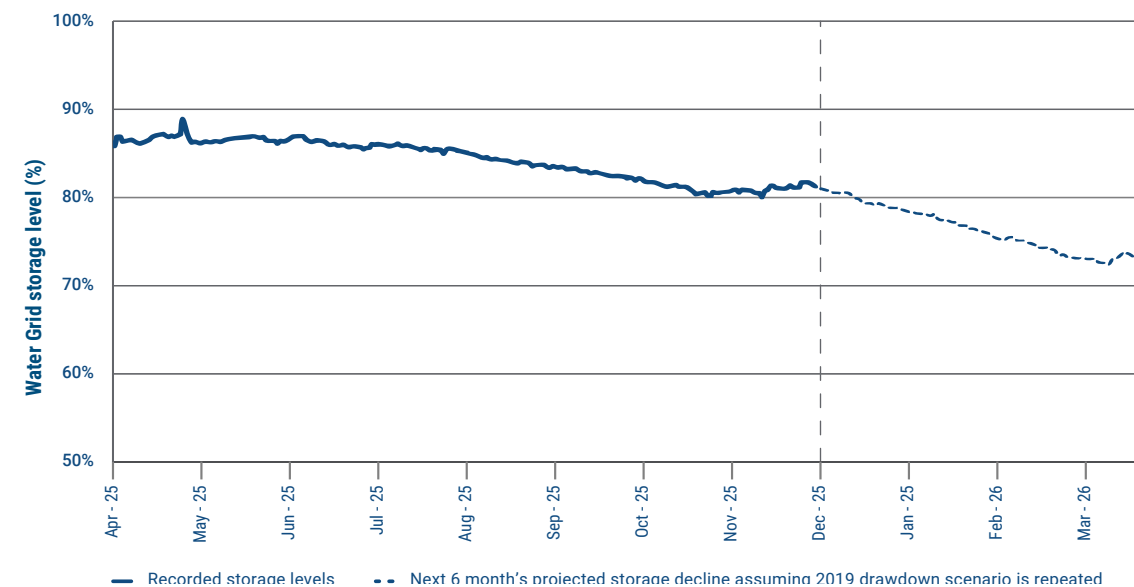

Average daily residential consumption

Average residential consumption in November was 162 litres per person per day (LPD). This represents a decrease in consumption compared to the 164 LPD recorded in the same month last year.

*Date range is 30/10/2025 - 26/11/2025 and 31/10/2024 - 27/11/2024

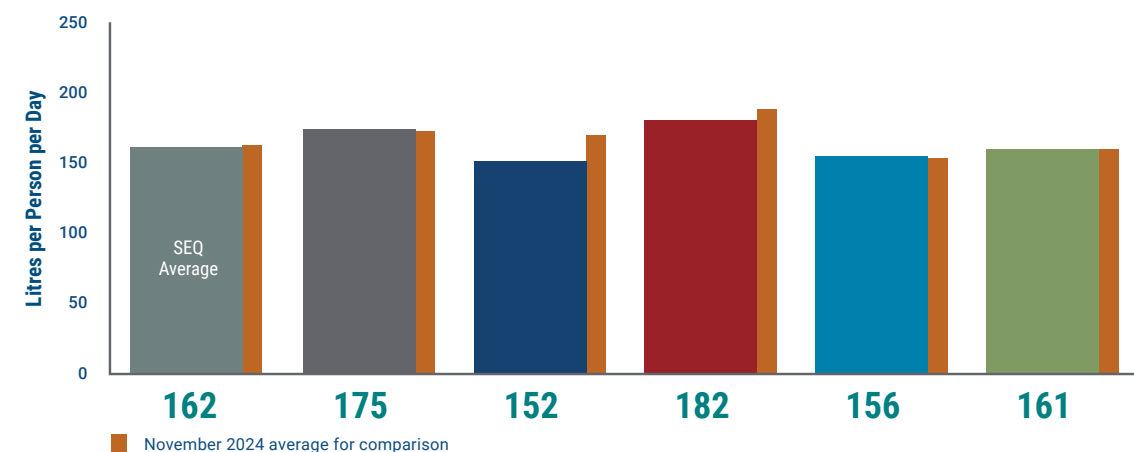

Water Grid operation


The Northern Pipeline Interconnector has been operated in a dual flow direction. The Southern Regional Water Pipeline has been operated in a dual flow direction.

Purified Recycled Water

The Western Corridor Recycled Water Scheme continues to provide some PRW to industrial customers.

Desalinated water production

Gold Coast Desalination Plant (GCDP) continues to operate at minimal levels, with Water Grid Storage levels above 70%, supporting planned works across the grid as required.

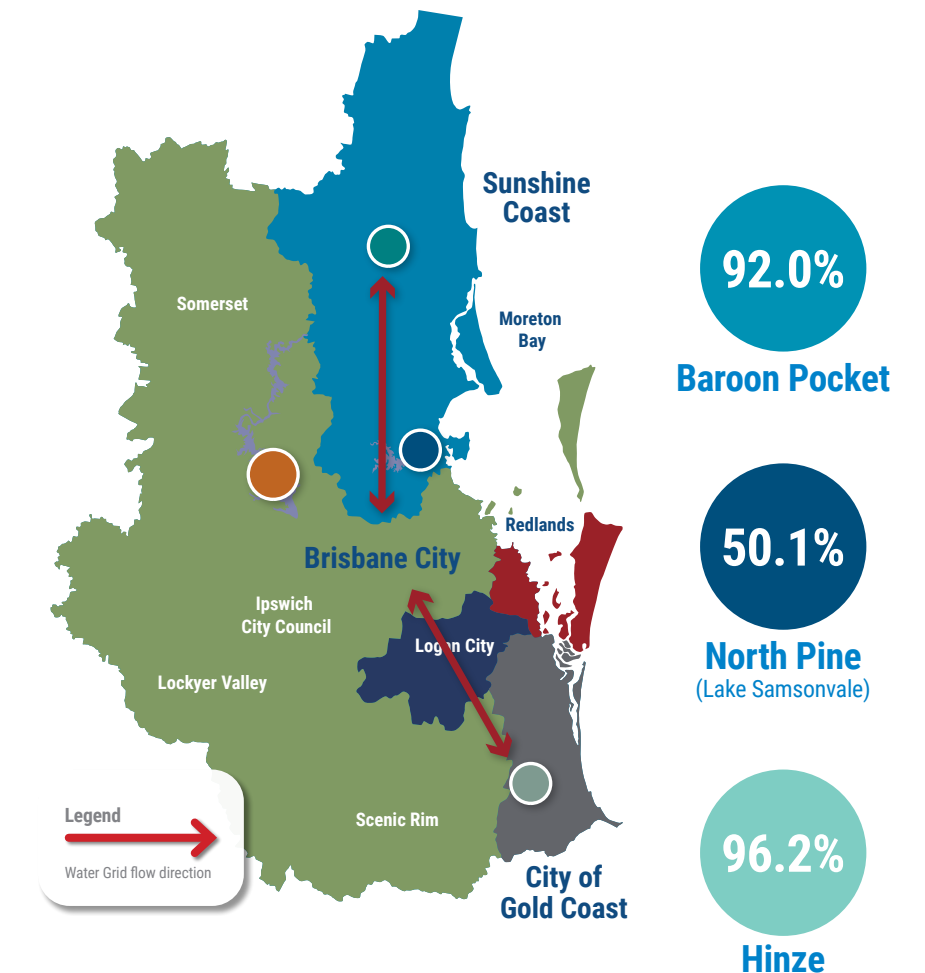


Wivenhoe/ Somerset (Combined)

Full supply capacity 1,545,089 ML

Current capacity 1,276,275 ML


Wivenhoe and Somerset Dams are SEQ's largest storages, and combined make up about 70% of the region's water supply (dams).

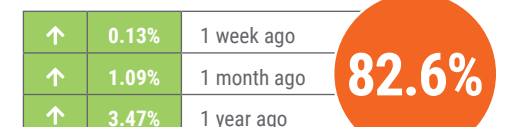

Weather outlook

Temperature

The Bureau of Meteorology (BOM) outlook is that there is an 60 to 80% chance of exceeding median maximum temperature from December to February 2026.

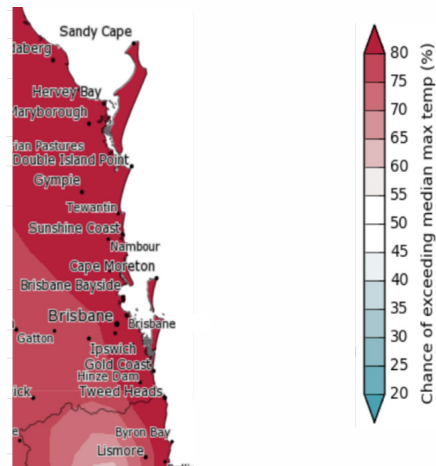


http://www.bom.gov.au/climate/outlooks/#/temperature/maximum/median/seasonal/0

*as at 4 December 2025

Rainfall

The BOM outlook is that there is a 50 to 55% chance of receiving above average rainfall from December to February 2026 across the SEQ region.

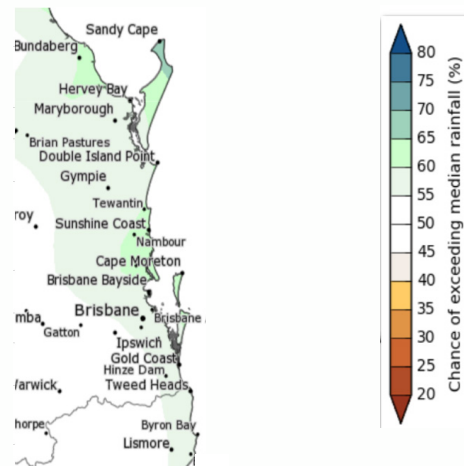

http://www.bom.gov.au/climate/outlooks/#/rainfall/median/seasonal/0

Off-grid community drought status

The SEQ Water Grid allows us to move treated drinking water around the region. Off-grid communities are not connected to the SEQ Water Grid.

*This data has been updated as at 30 November 2025

Sunshine Coast Regional Council

1	Kenilworth	Mary River at Bellbird Creek flow: 68 ML/day	●	●
---	-------------------	--	---	---

Moreton Bay Regional Council

2	Dayboro	Groundwater Well No 1 standing water level: 40.68	●	●
---	----------------	---	---	---

Somerset Regional Council


3	Jimna	Yabba Creek flow - Big Hole Weir is flowing.	●	●
4	Linville	Brisbane River at Linville 821.5 ML/day	●	●

Redland City Council

5	Amity Point			
6	Point Lookout	North Stradbroke Island Groundwater standing water level (primary bore): 20.56 m AHD	●	●
7	Dunwich			

Scenic Rim Regional Council

8	Kalbar (Boonah, Aratula and Mount Alford)	Moogerah Dam storage level: 94%	●	●
9	Canungra	Canungra Creek flow: 34.7 ML/day	●	●
10	Beaudesert			
11	Kooralbyn	Maroon Dam storage level: 99.6%	●	●
12	Rathdowney			

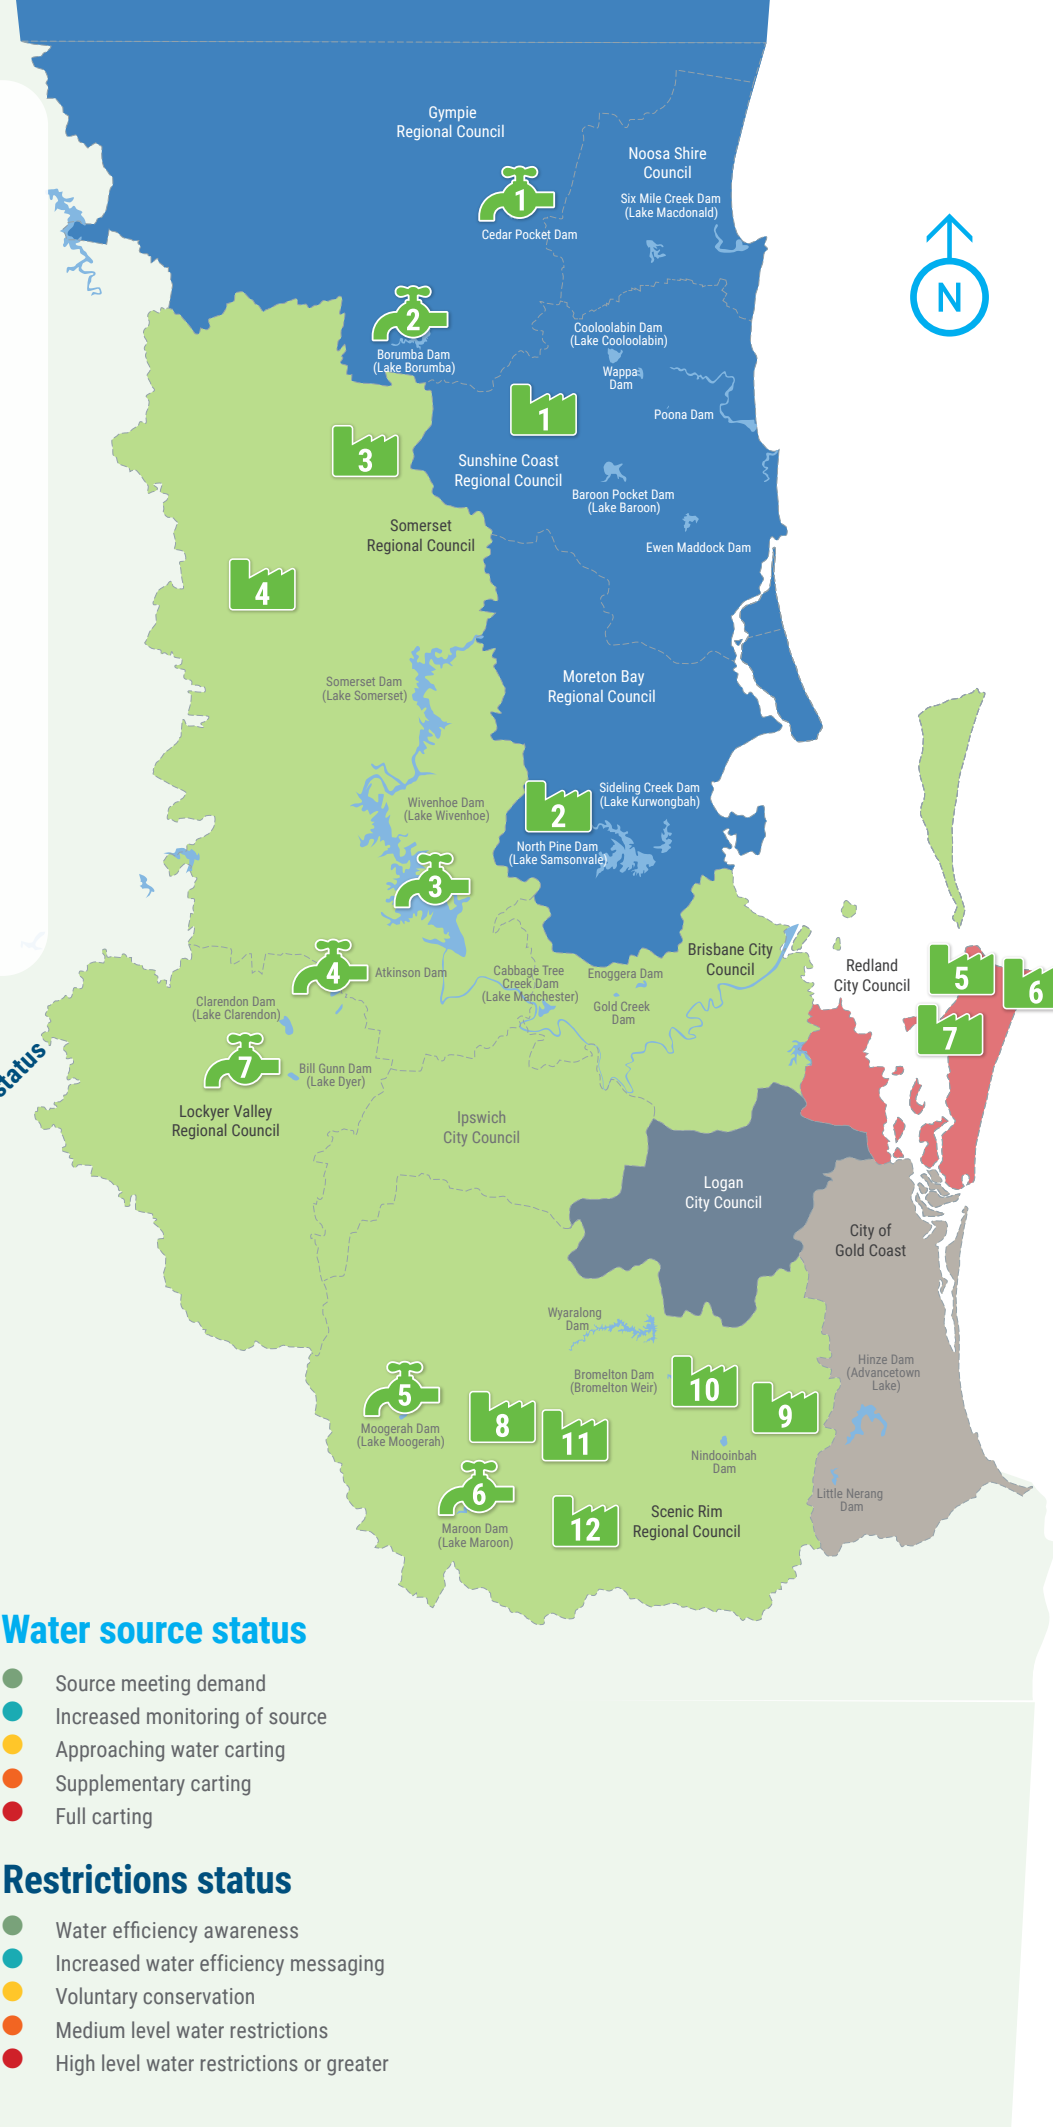

Water supply scheme status

Seqwater supplies water to rural landholders and businesses that are licensed to take water from dams and waterways via water supply schemes. The amount of water that can be extracted by licensed irrigators varies according to local water conditions. In times of drought or low flows, irrigation entitlements may be restricted or suspended.
*as at 30 November 2025



Full allocation



Restricted



Suspended



Cedar Pocket Water Supply Scheme

Cedar Pocket Dam currently 100.2% (Up 13.5% from last month)
Announced Allocations Medium Priority 100%



Mary Valley Water Supply Scheme

Borumba Dam currently 100.2% (Up 0.5% from last month)
Announced Allocations Medium Priority 100% (also supplies high priority)



Central Brisbane Water Supply Scheme

Wivenhoe Dam/Somerset Dam currently 82.6% (Up 1.1% from last month)
Announced Allocations Medium Priority 100% (also supplies high priority)



Lower Lockyer Water Supply Scheme

Atkinson Dam currently 92.8% (Down 0.4% from last month)
Announced Allocations Medium Priority 100%



Warrill Valley Water Supply Scheme

Moogerah Dam currently 94% (Down 0.8% from last month)
Announced Allocations Medium Priority 100% (also supplies high priority)



Logan River Water Supply Scheme

Maroon Dam currently 99.6% (Up 0.7% from last month)
Announced Allocations Medium Priority 100% (also supplies high priority)



Central Lockyer Water Supply Scheme

Clarendon Dam & Bill Gunn Dam currently 99.7% (Up 5.8% from last month)
Announced allocation (surface water) Morton Vale 100%, Medium Priority Zones 100%
Announced allocation (groundwater) Medium Priority 100%, Low Priority 100%

Water source status

- Source meeting demand
- Increased monitoring of source
- Approaching water carting
- Supplementary carting
- Full carting

Restrictions status

- Water efficiency awareness
- Increased water efficiency messaging
- Voluntary conservation
- Medium level water restrictions
- High level water restrictions or greater